



Sieve Analysis Report

CLIENT: Metro Green
100A Oak Street
Mt. Vernon, NY 10550

DATE: June 24, 2019

PROJECT: 100A Oak Street
Mt. Vernon, NY 10550

LAB NO: 16257

SAMPLE ID: Item 4

INSPECTOR: J. Aviles


Sieve Size	RESULTS		RESULTS	
	Weight Retained	% Retained	% Passing	
¾"	0	0	100	
½"	.070	4.78	94.64	
3/8"	.120	8.19	90.48	
#4	.215	14.68	82.27	
#10	.255	17.41	67.59	
#50	.490	33.45	50.18	
#100	.135	9.22	16.73	
#200	.075	5.12	7.51	
Pan	.35	2.39	2.39	

1.5
4.65
0.35
2.38% Moisture

RZ/dk

Respectfully submitted,
CERTIFIED TESTING LABORATORIES

Richard J. Zalcum
Richard J. Zalcum, PE

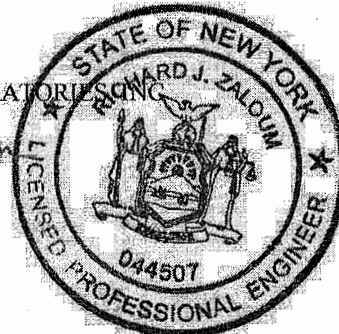


CTL SOF S-3
6/1/12
RZ

CLIENT: Metro Green

GRAIN SIZE DISTRIBUTION

U.S. STANDARD SIEVE SIZE

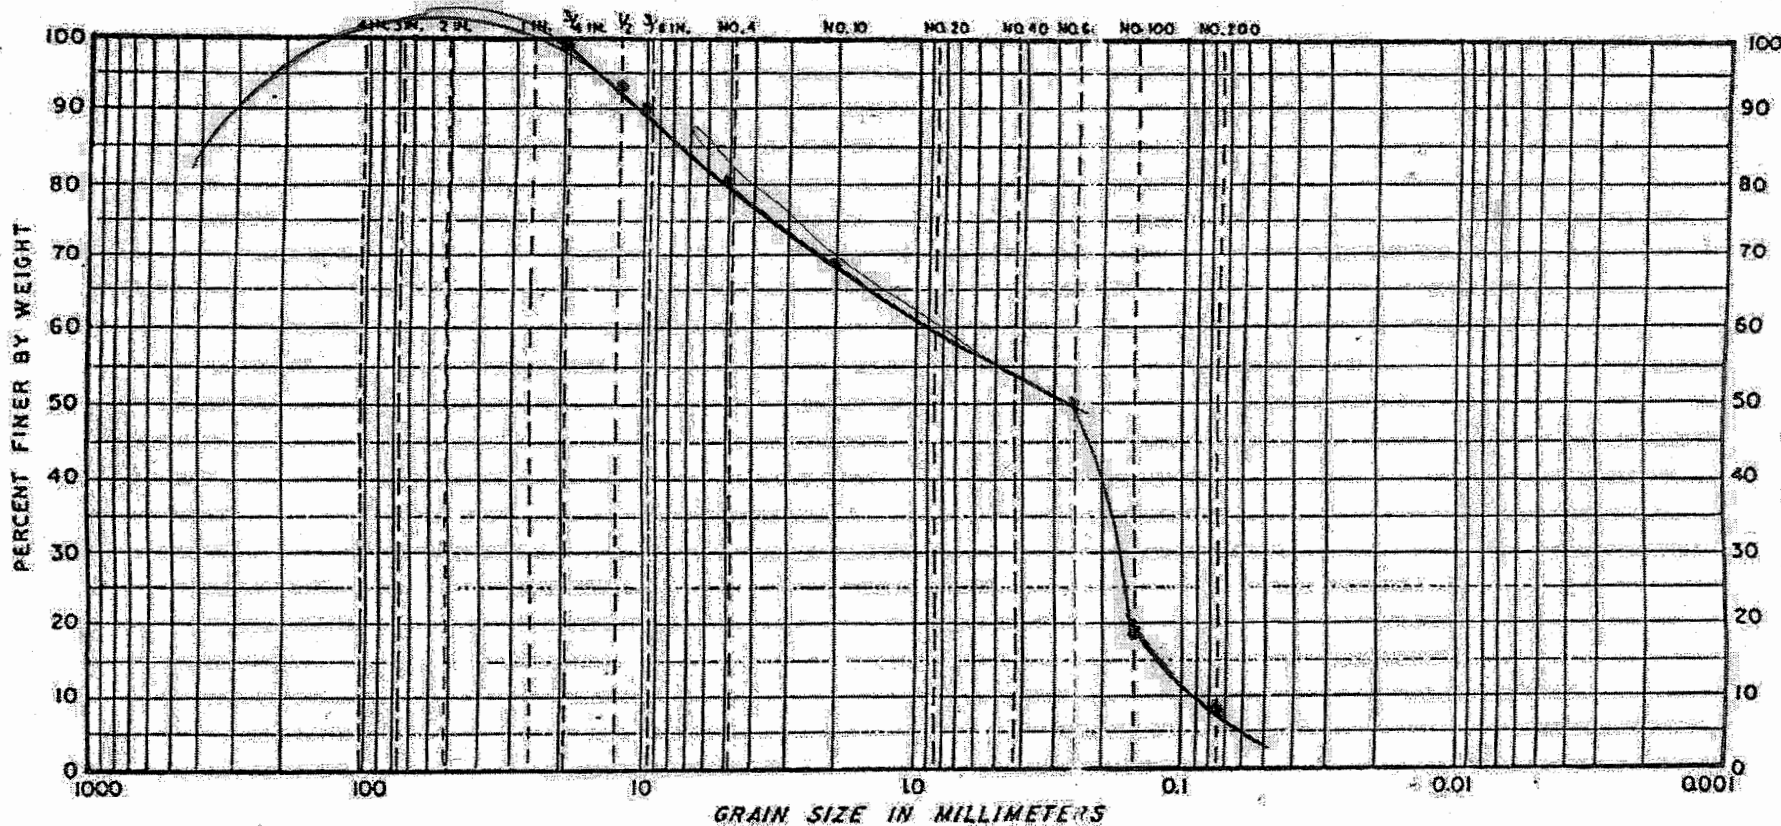

COBBLES	GRAVEL		SAND			SILT OR CLAY
	COARSE	FINE	COARSE	MEDIUM	FINE	

UNIFIED SOIL CLASSIFICATION SYSTEM, CORPS OF ENGINEERS, U.S. ARMY

BORING # _____
 SAMPLE # _____
 IDENTIFICATION # 1 RCA # 4
Fine, Medium, Coarse SAND
and fine gravel

BLOW COUNTS _____



PROJECT 100A OAK ST.
MT. Vernon NY
 NO. _____ DATE _____